



CONTROL CABINET


Electrical schematic diagram


JY-RD-03-21-07


			DATE	2022/5/27	Jiangyin Juyuan Intelligent Technology Co., Ltd.	1MW MINER LIQUID COOLING SYSTEM	TITLE PAGE	=
			AUTHOR					+ CABINET_C
			CHECK					Page 1
MODIFY	DATE	NAME						43 Page / 55

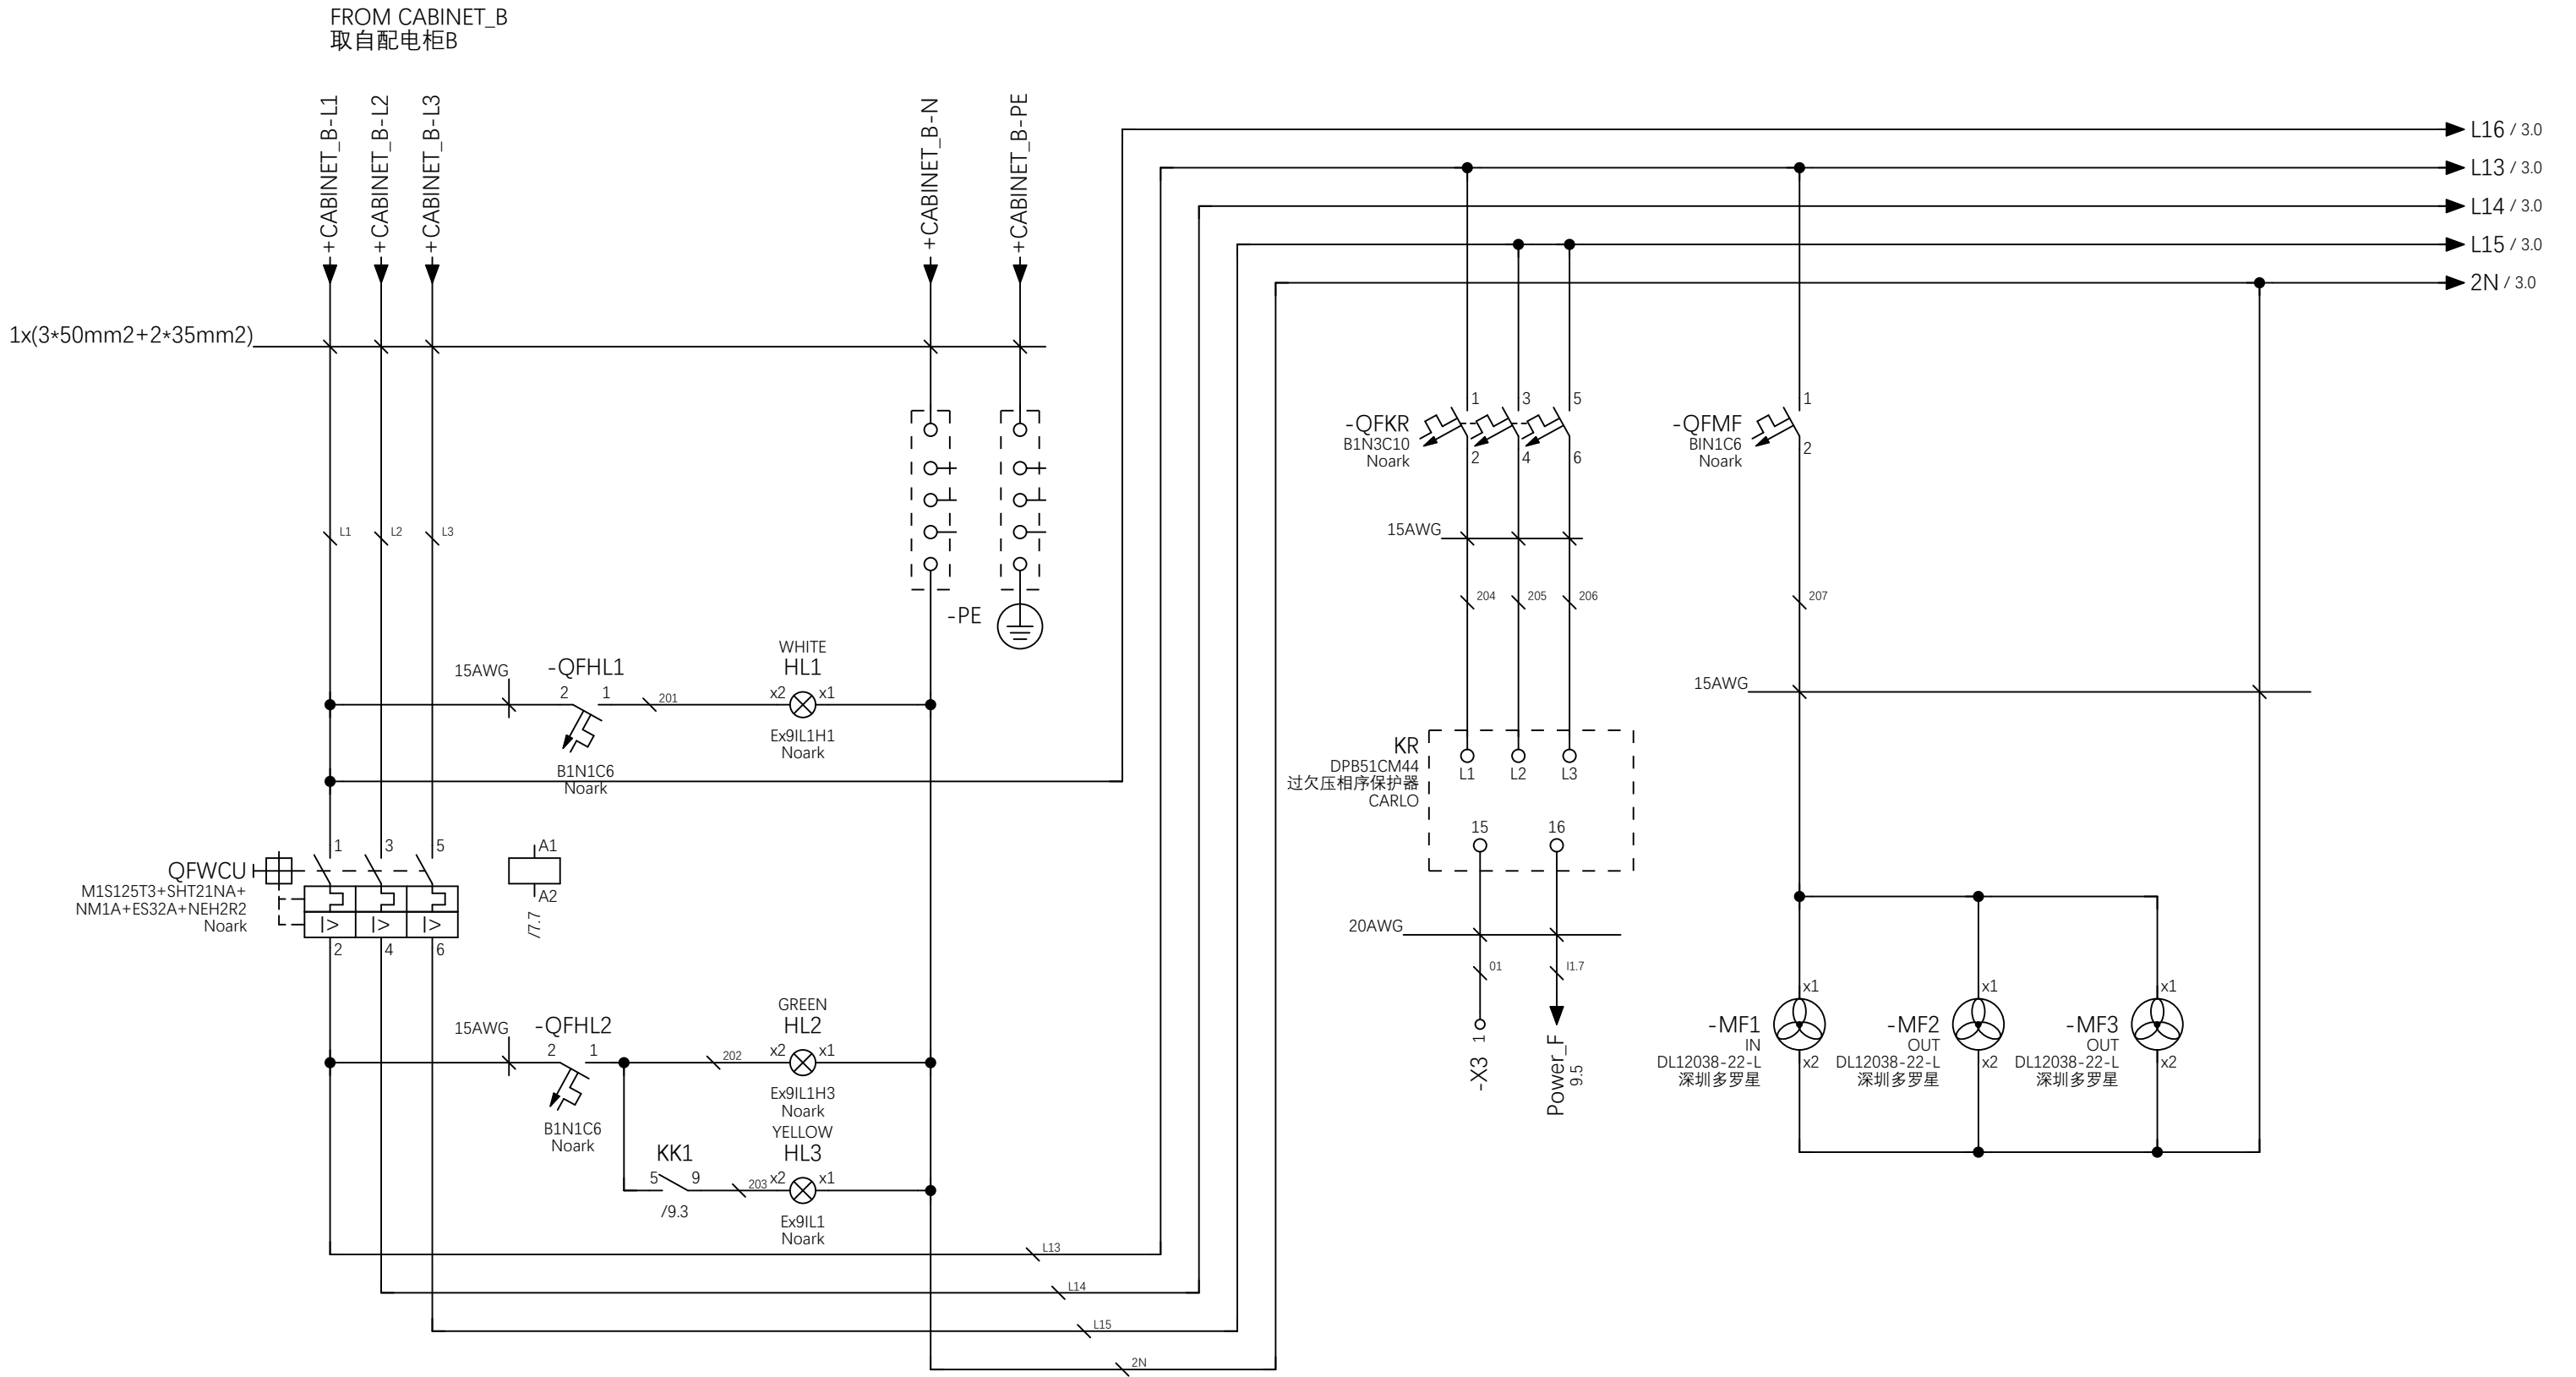


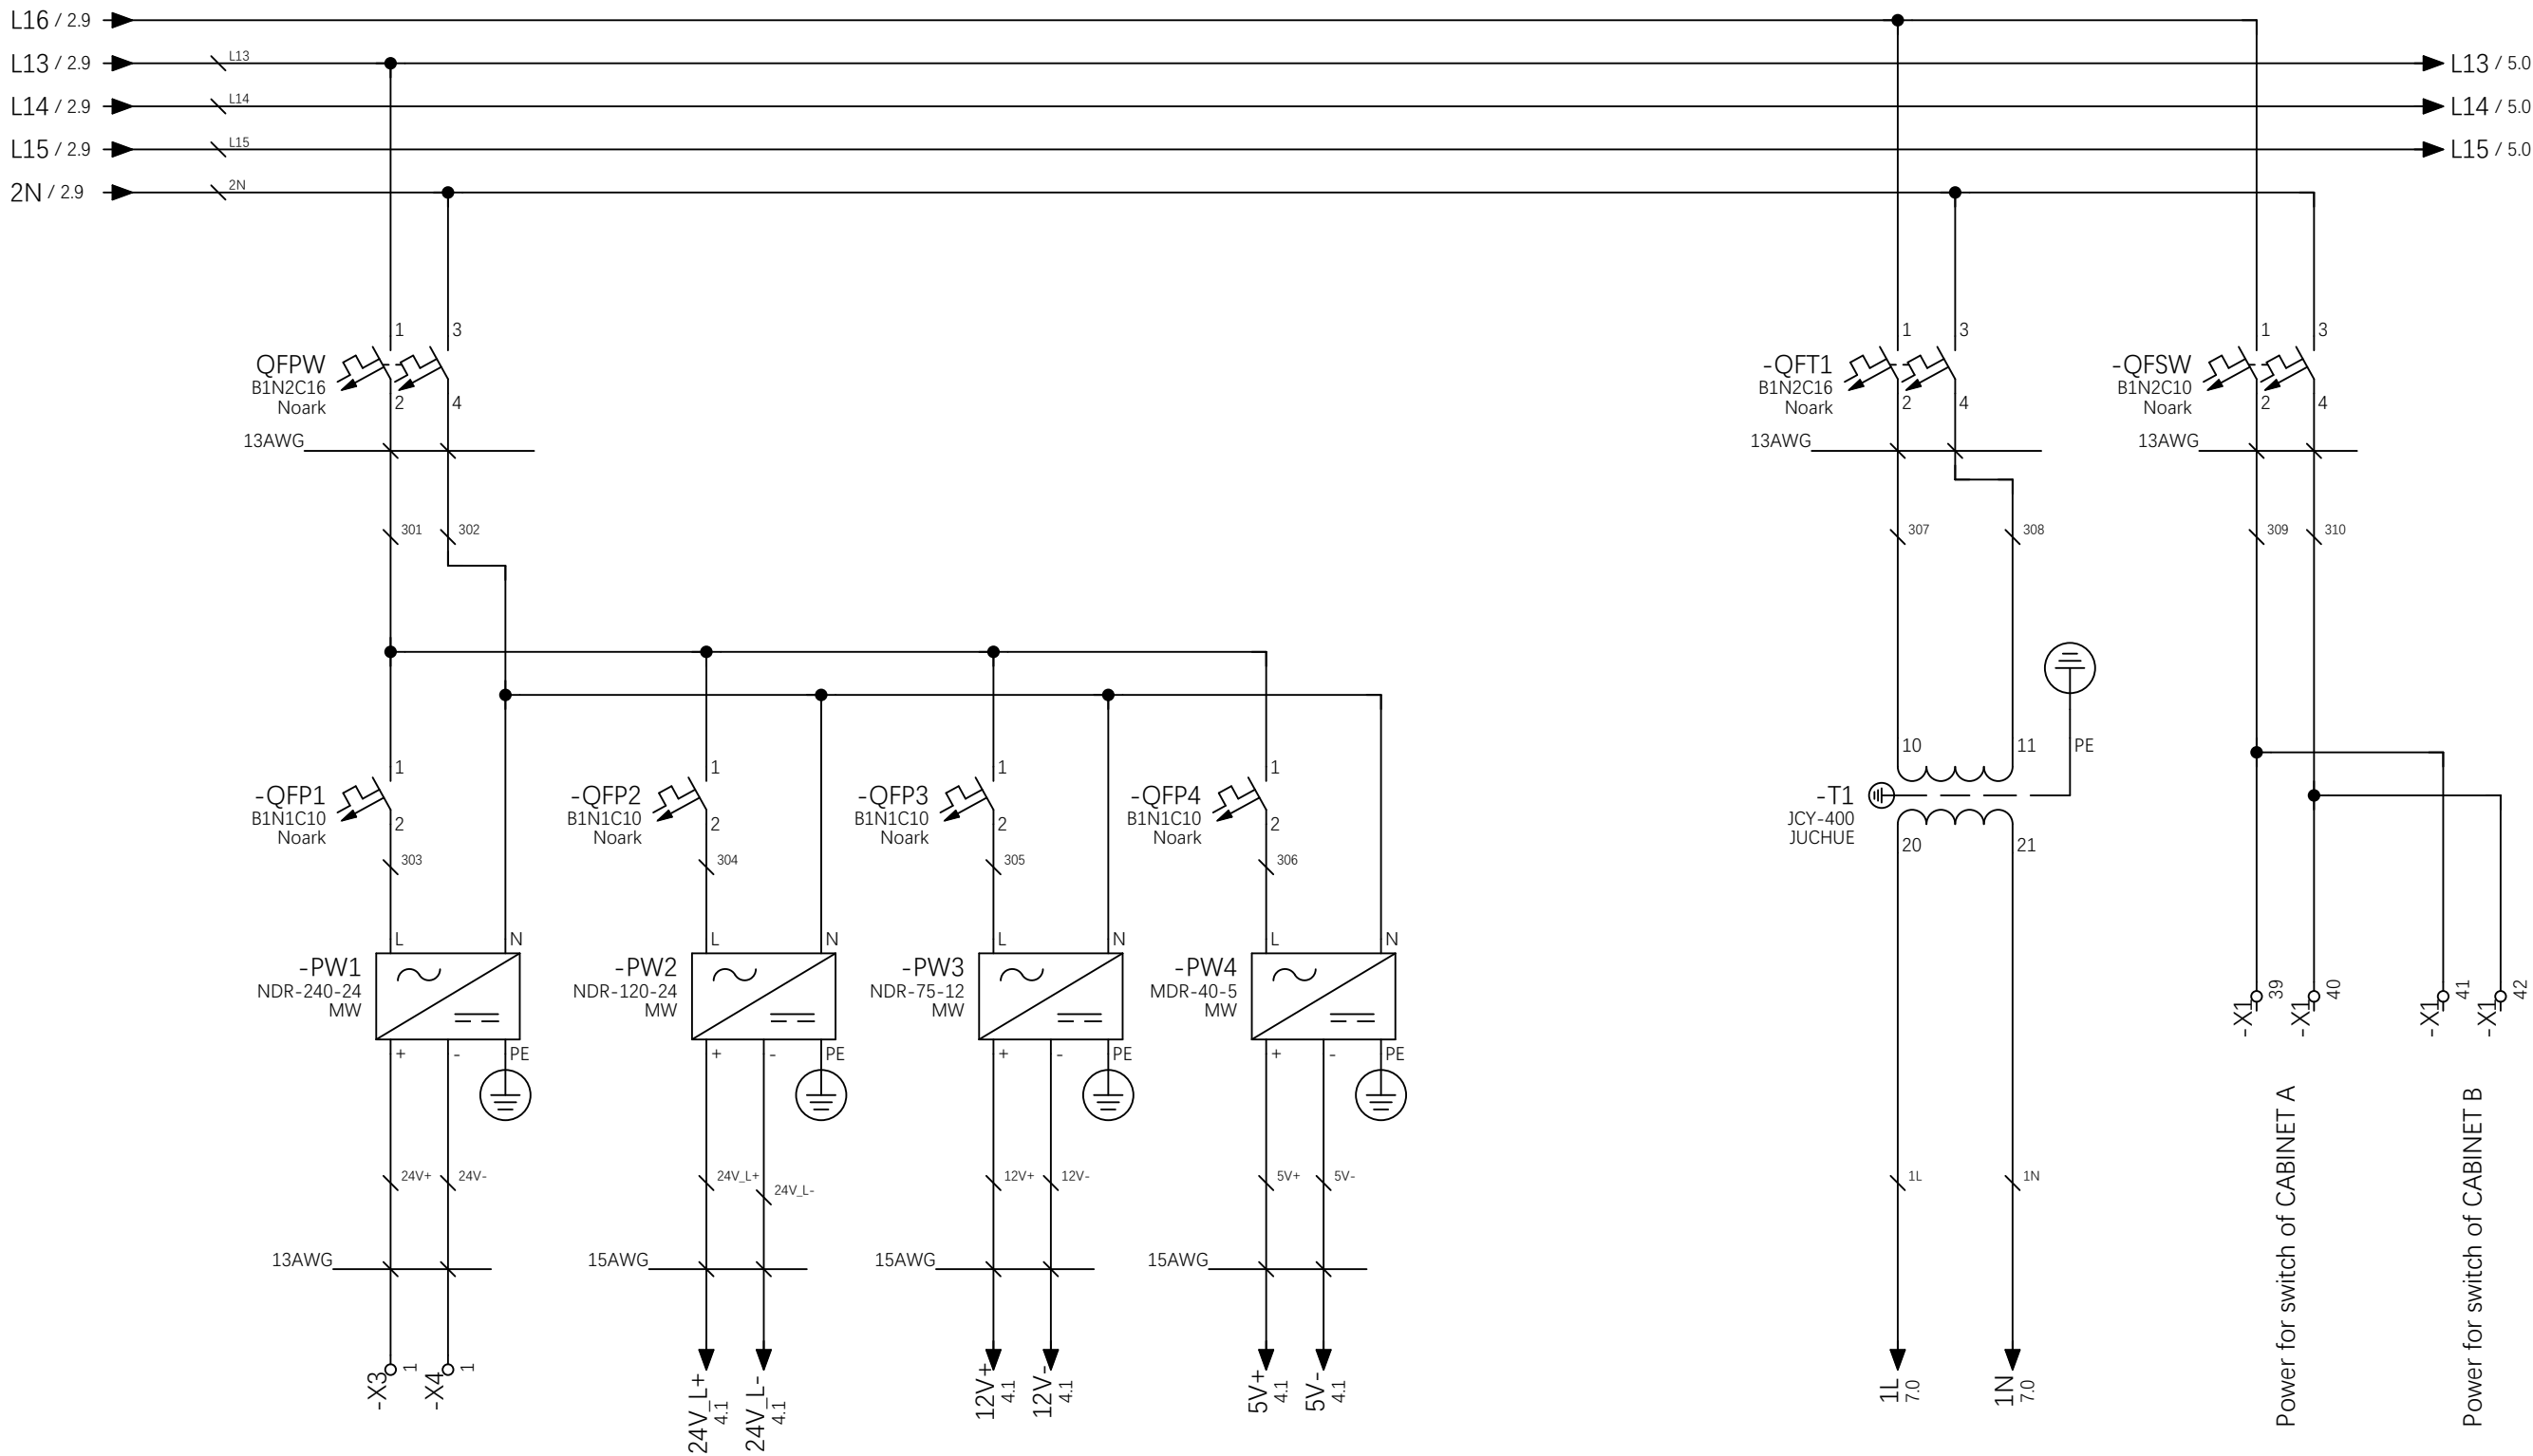


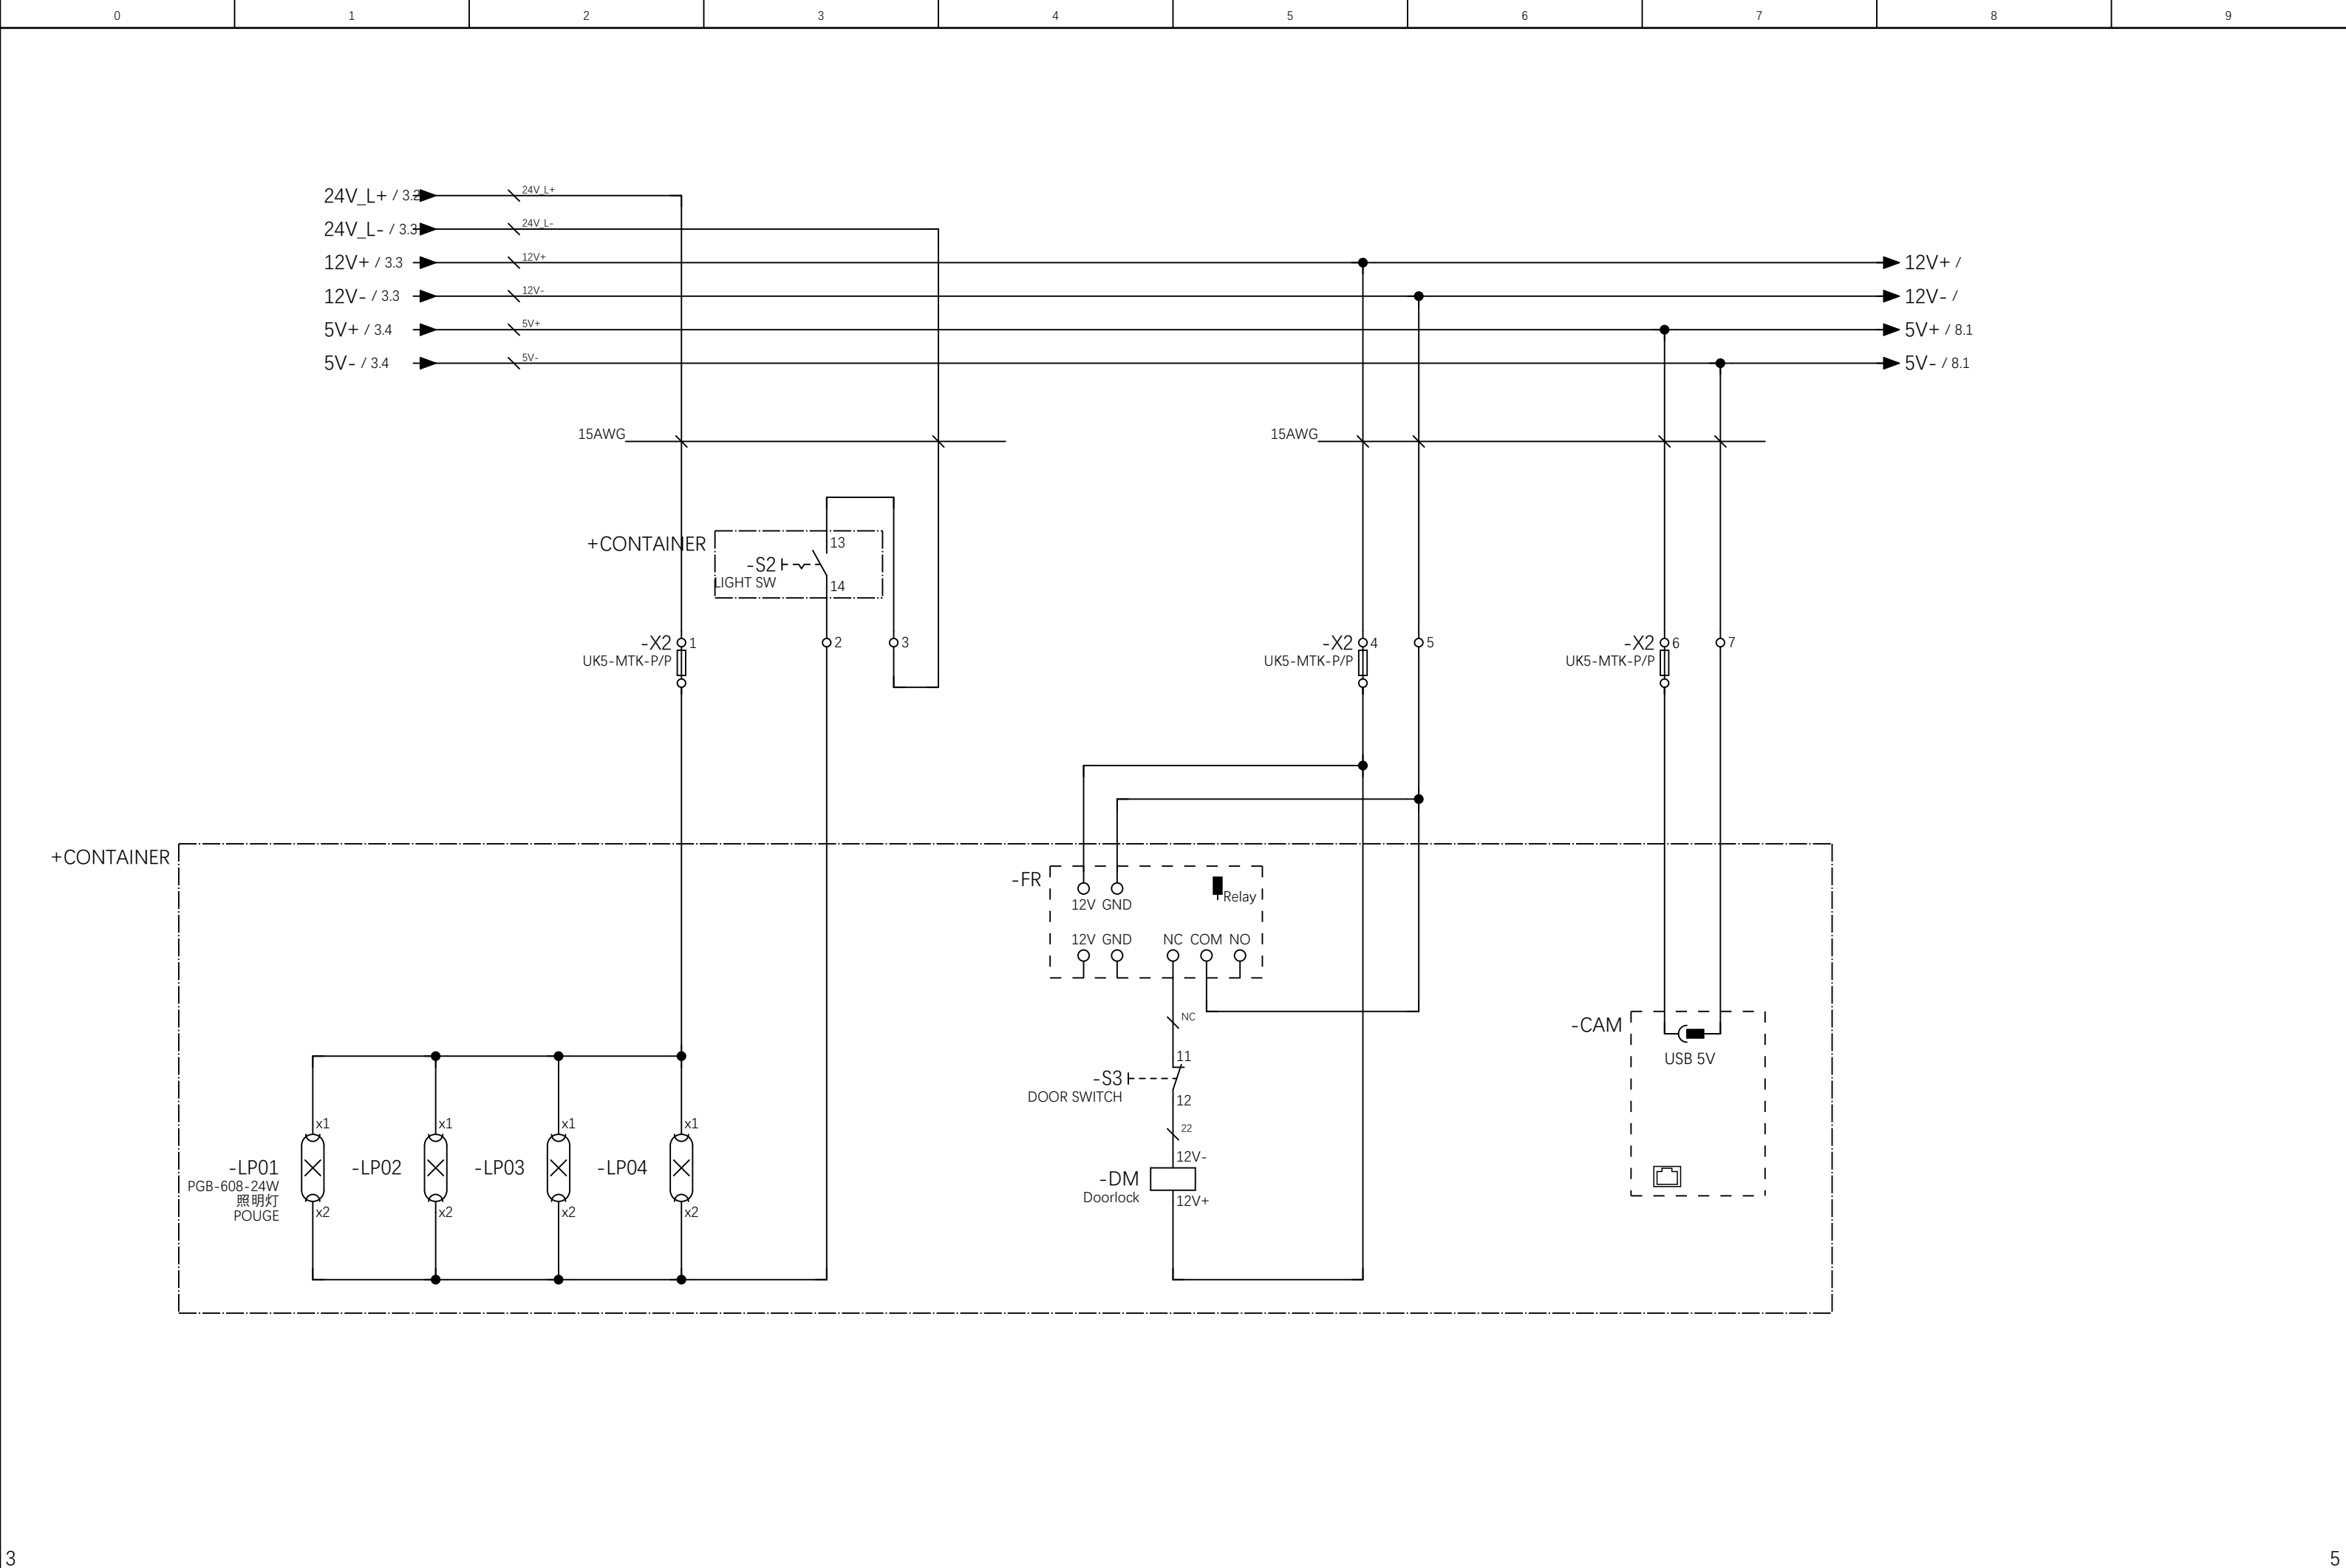


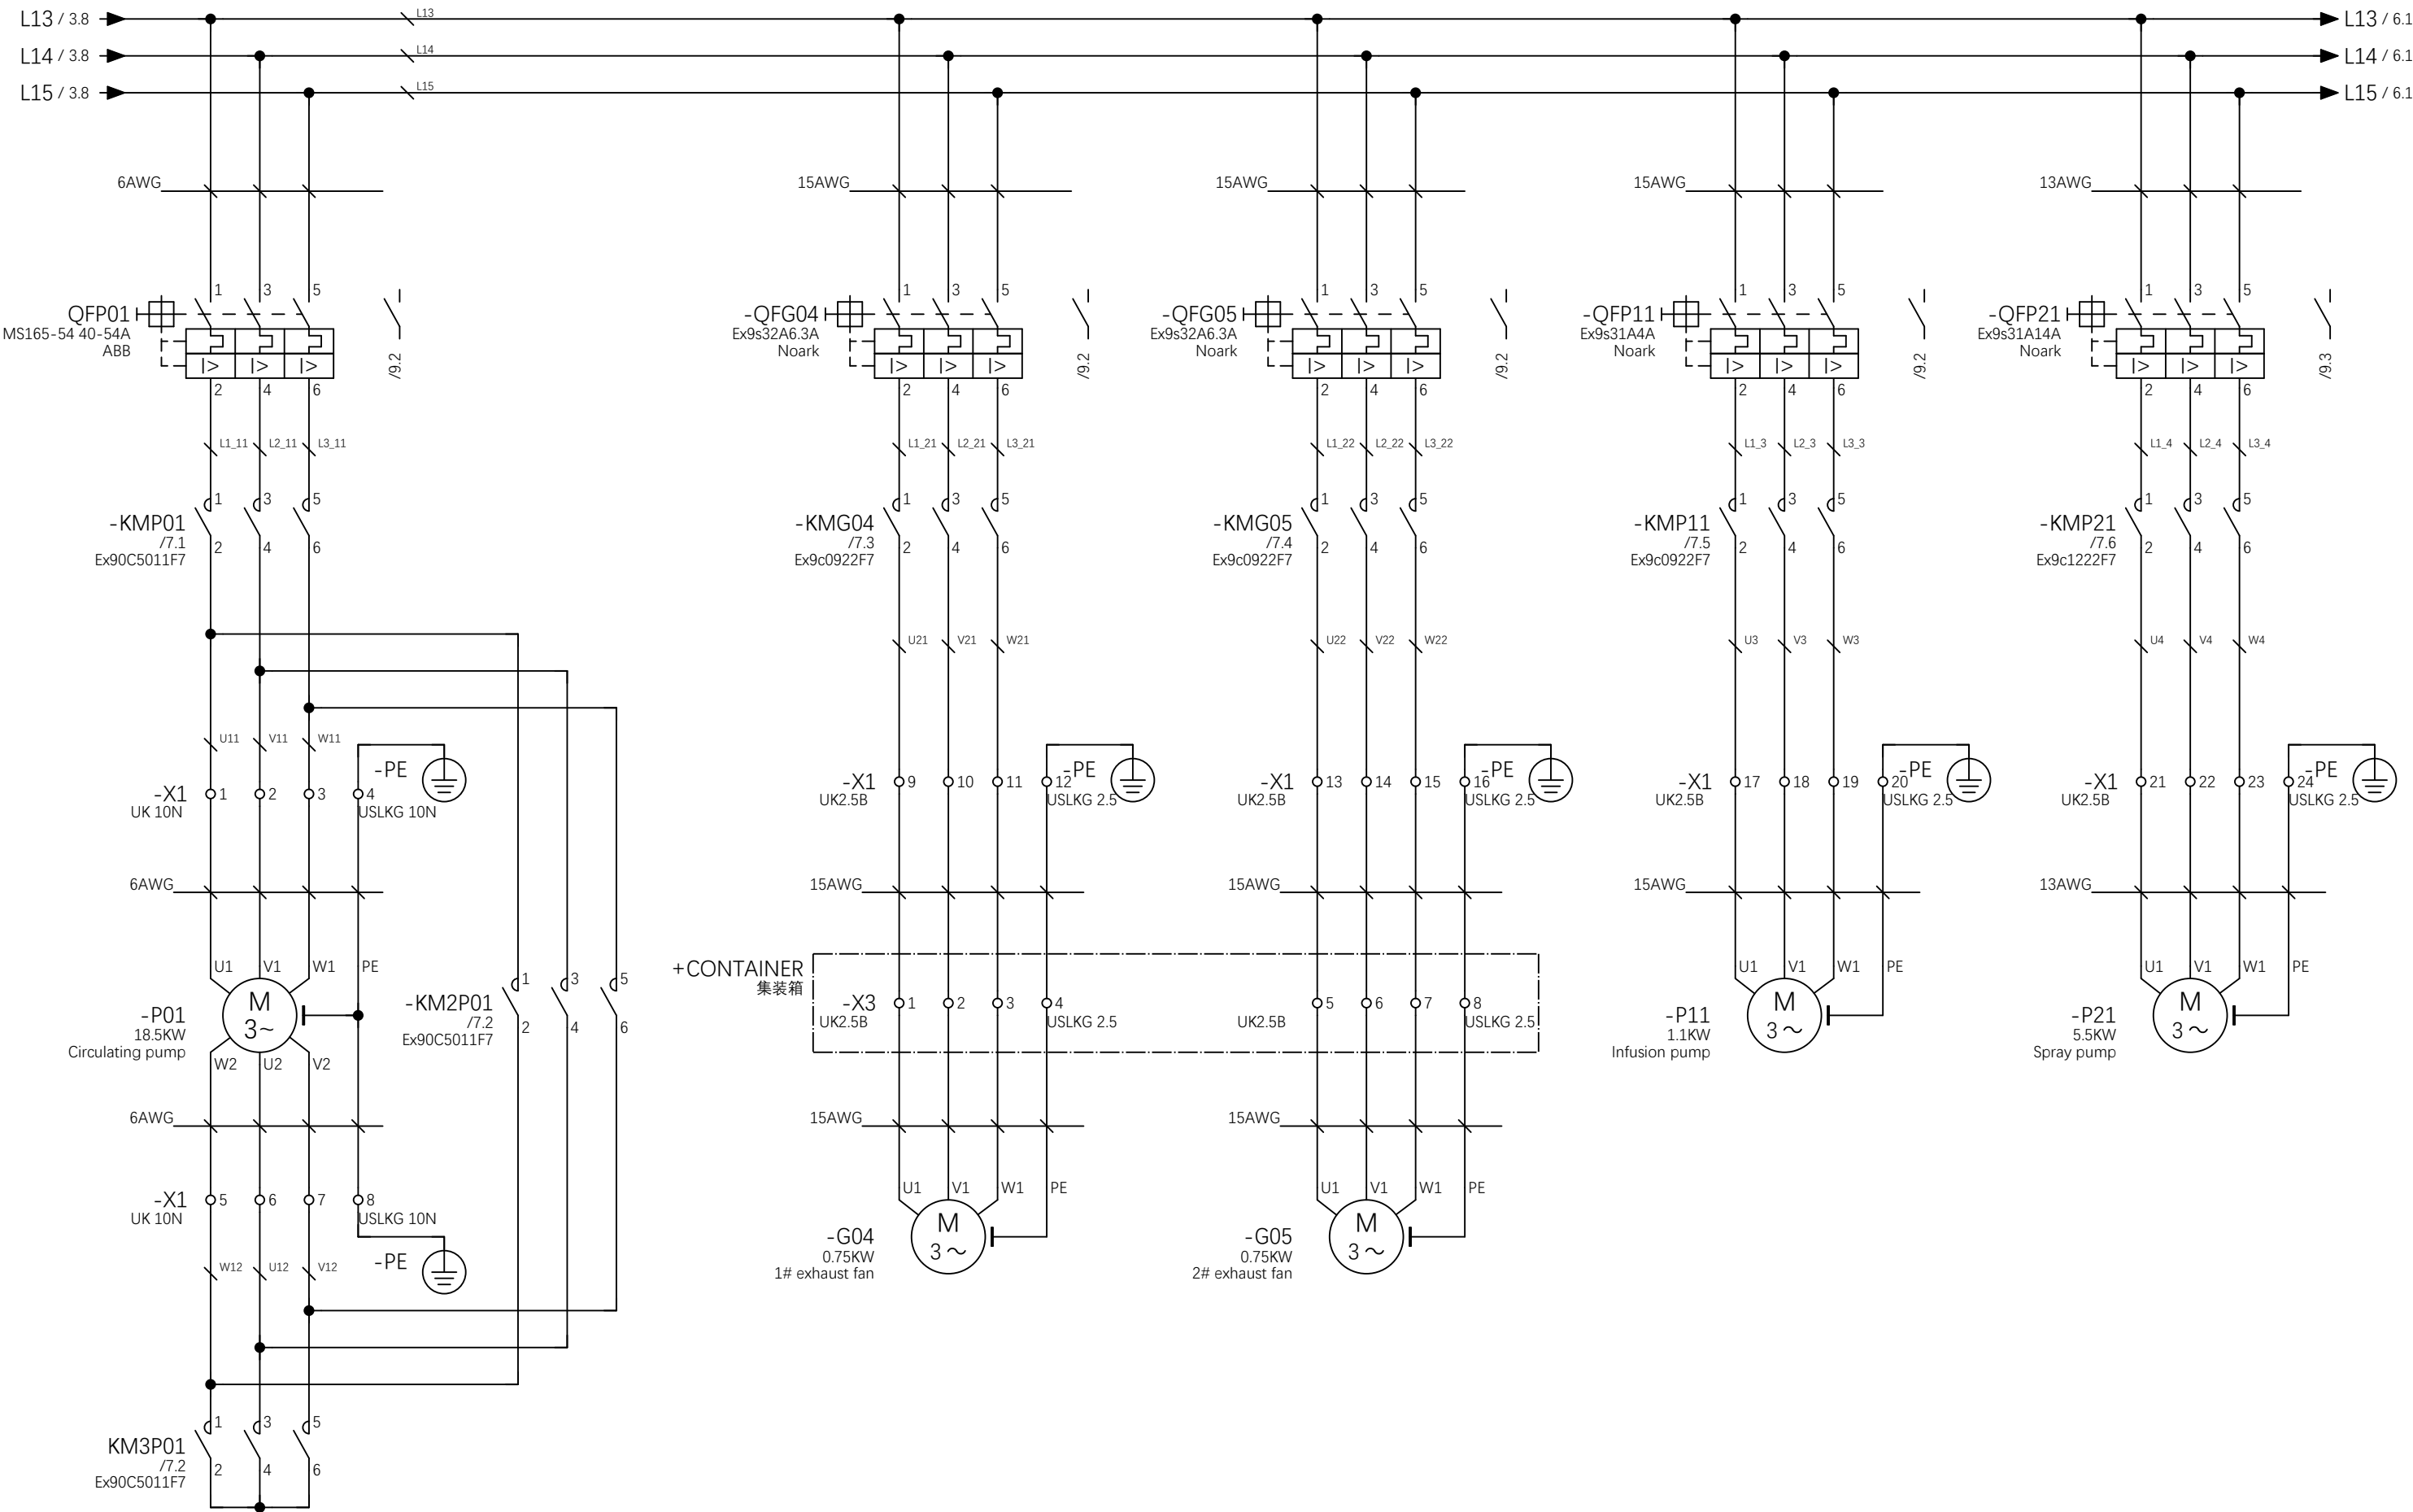


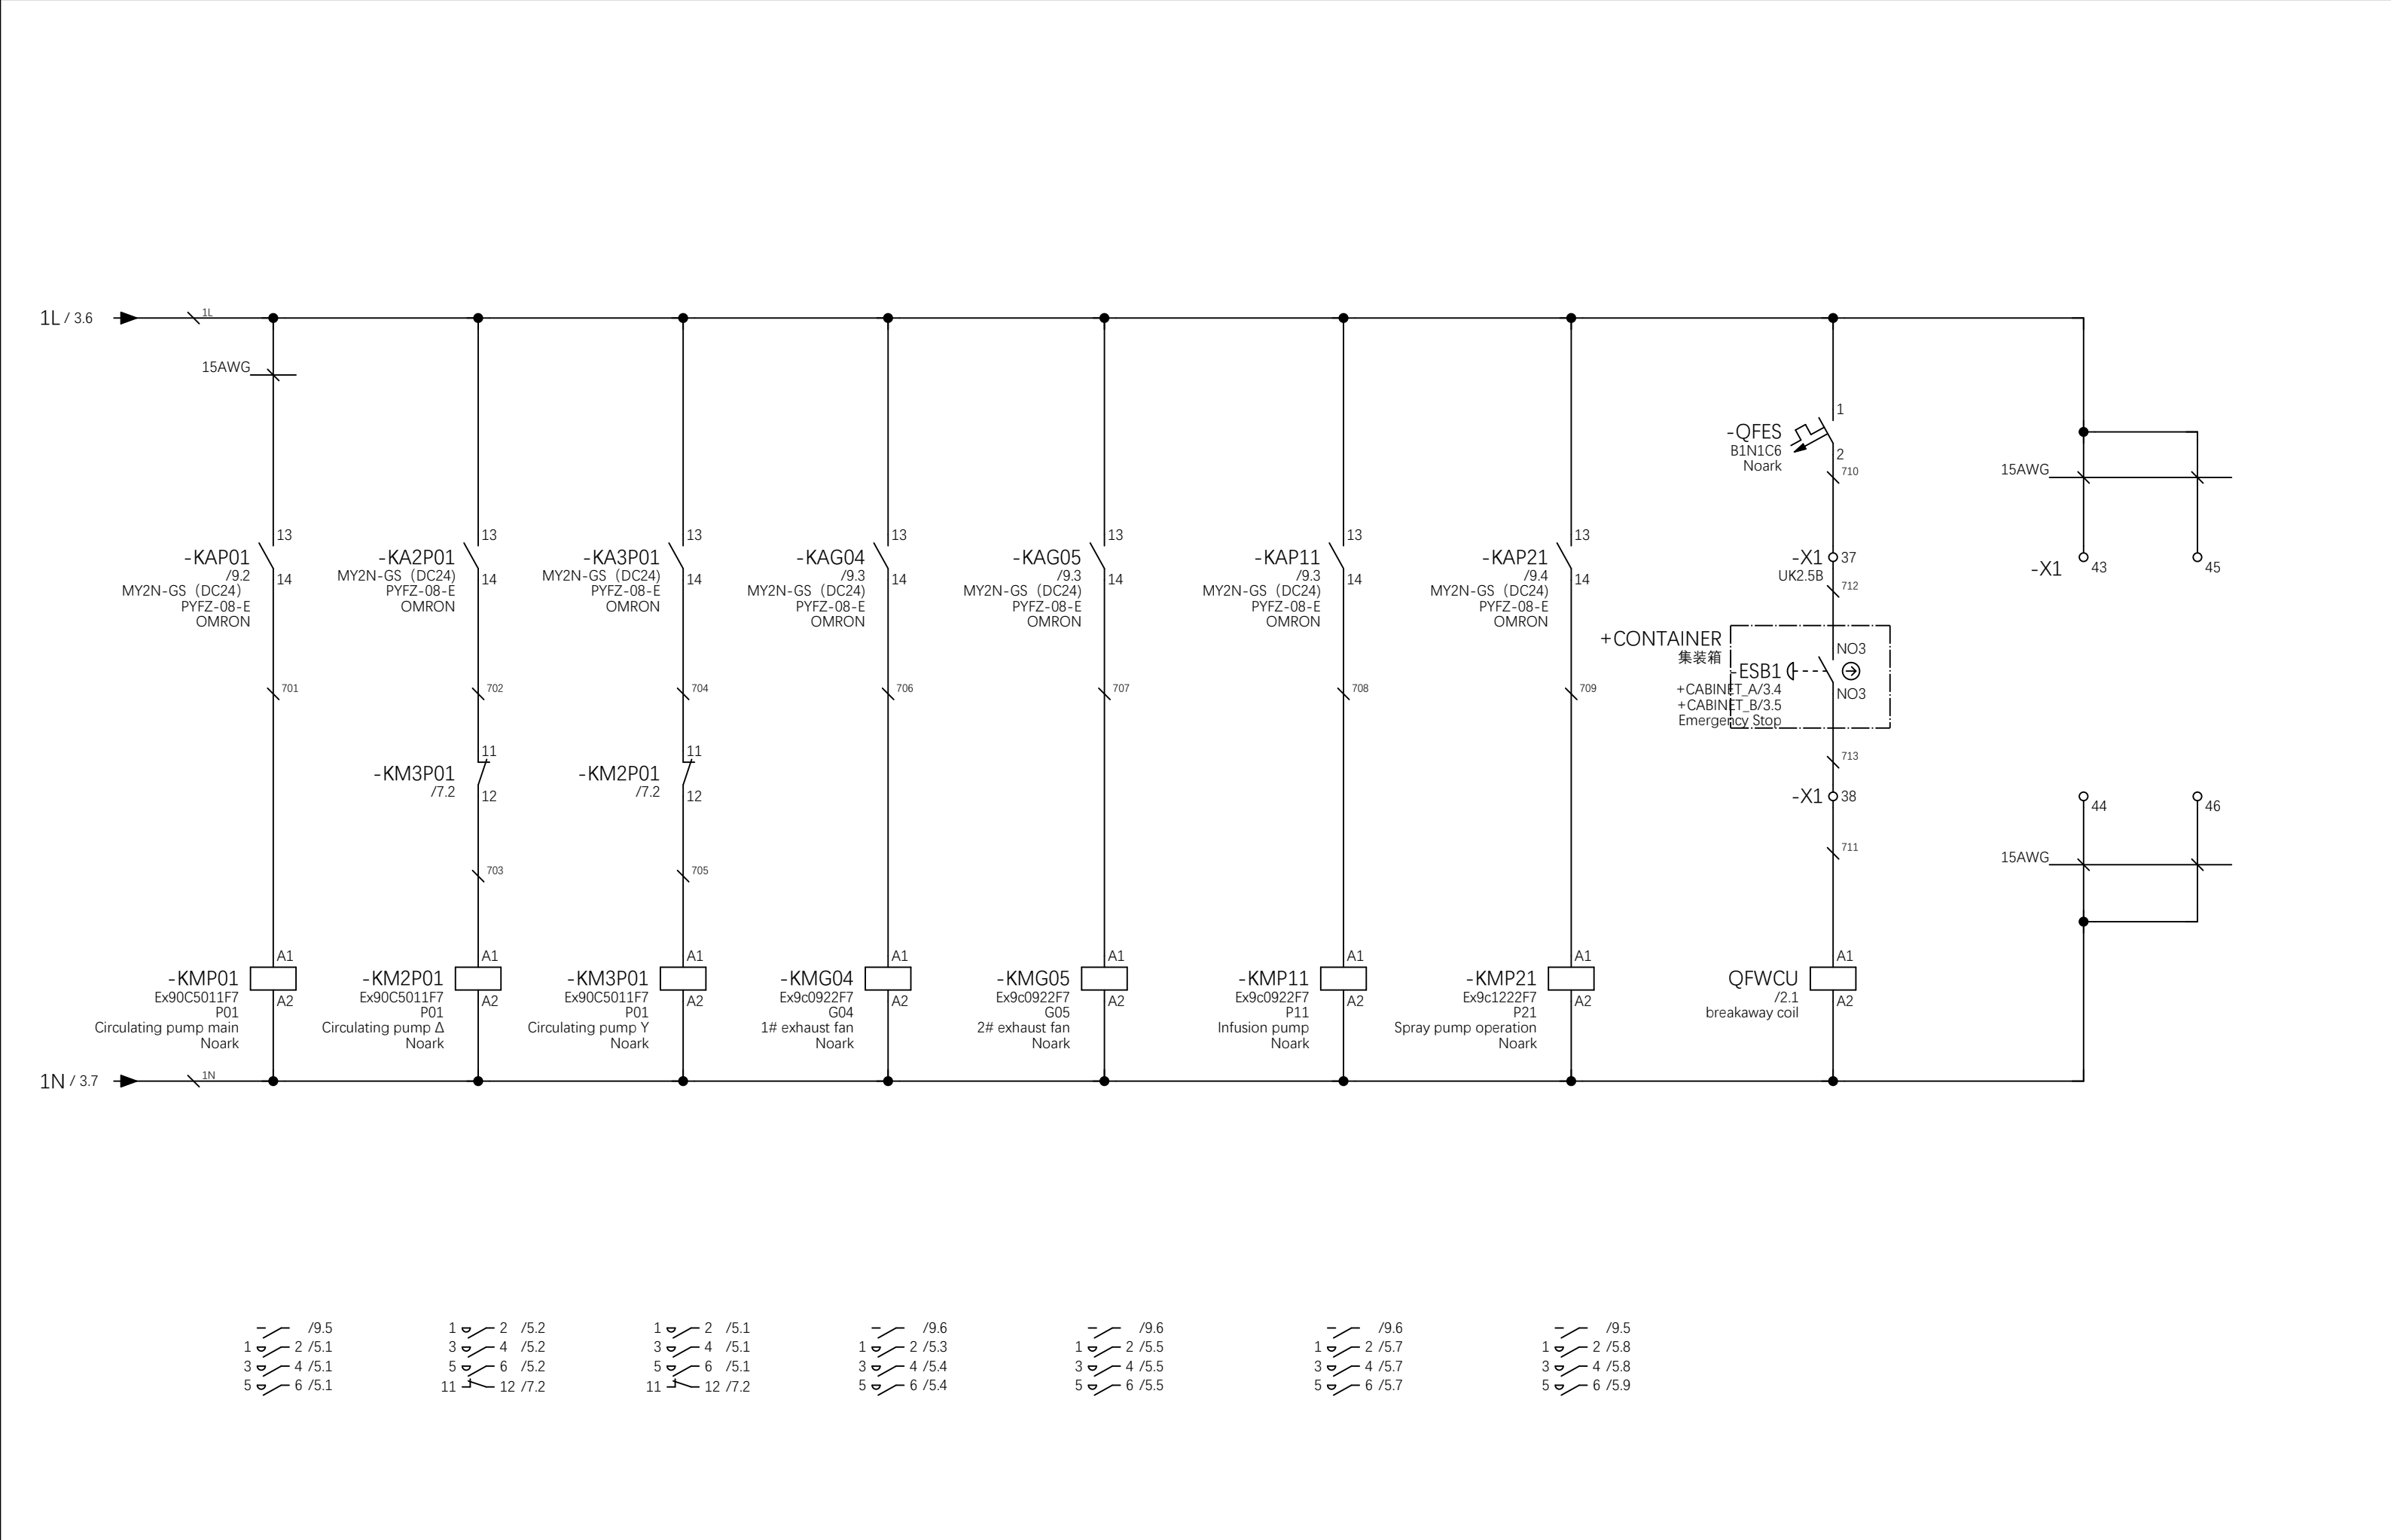

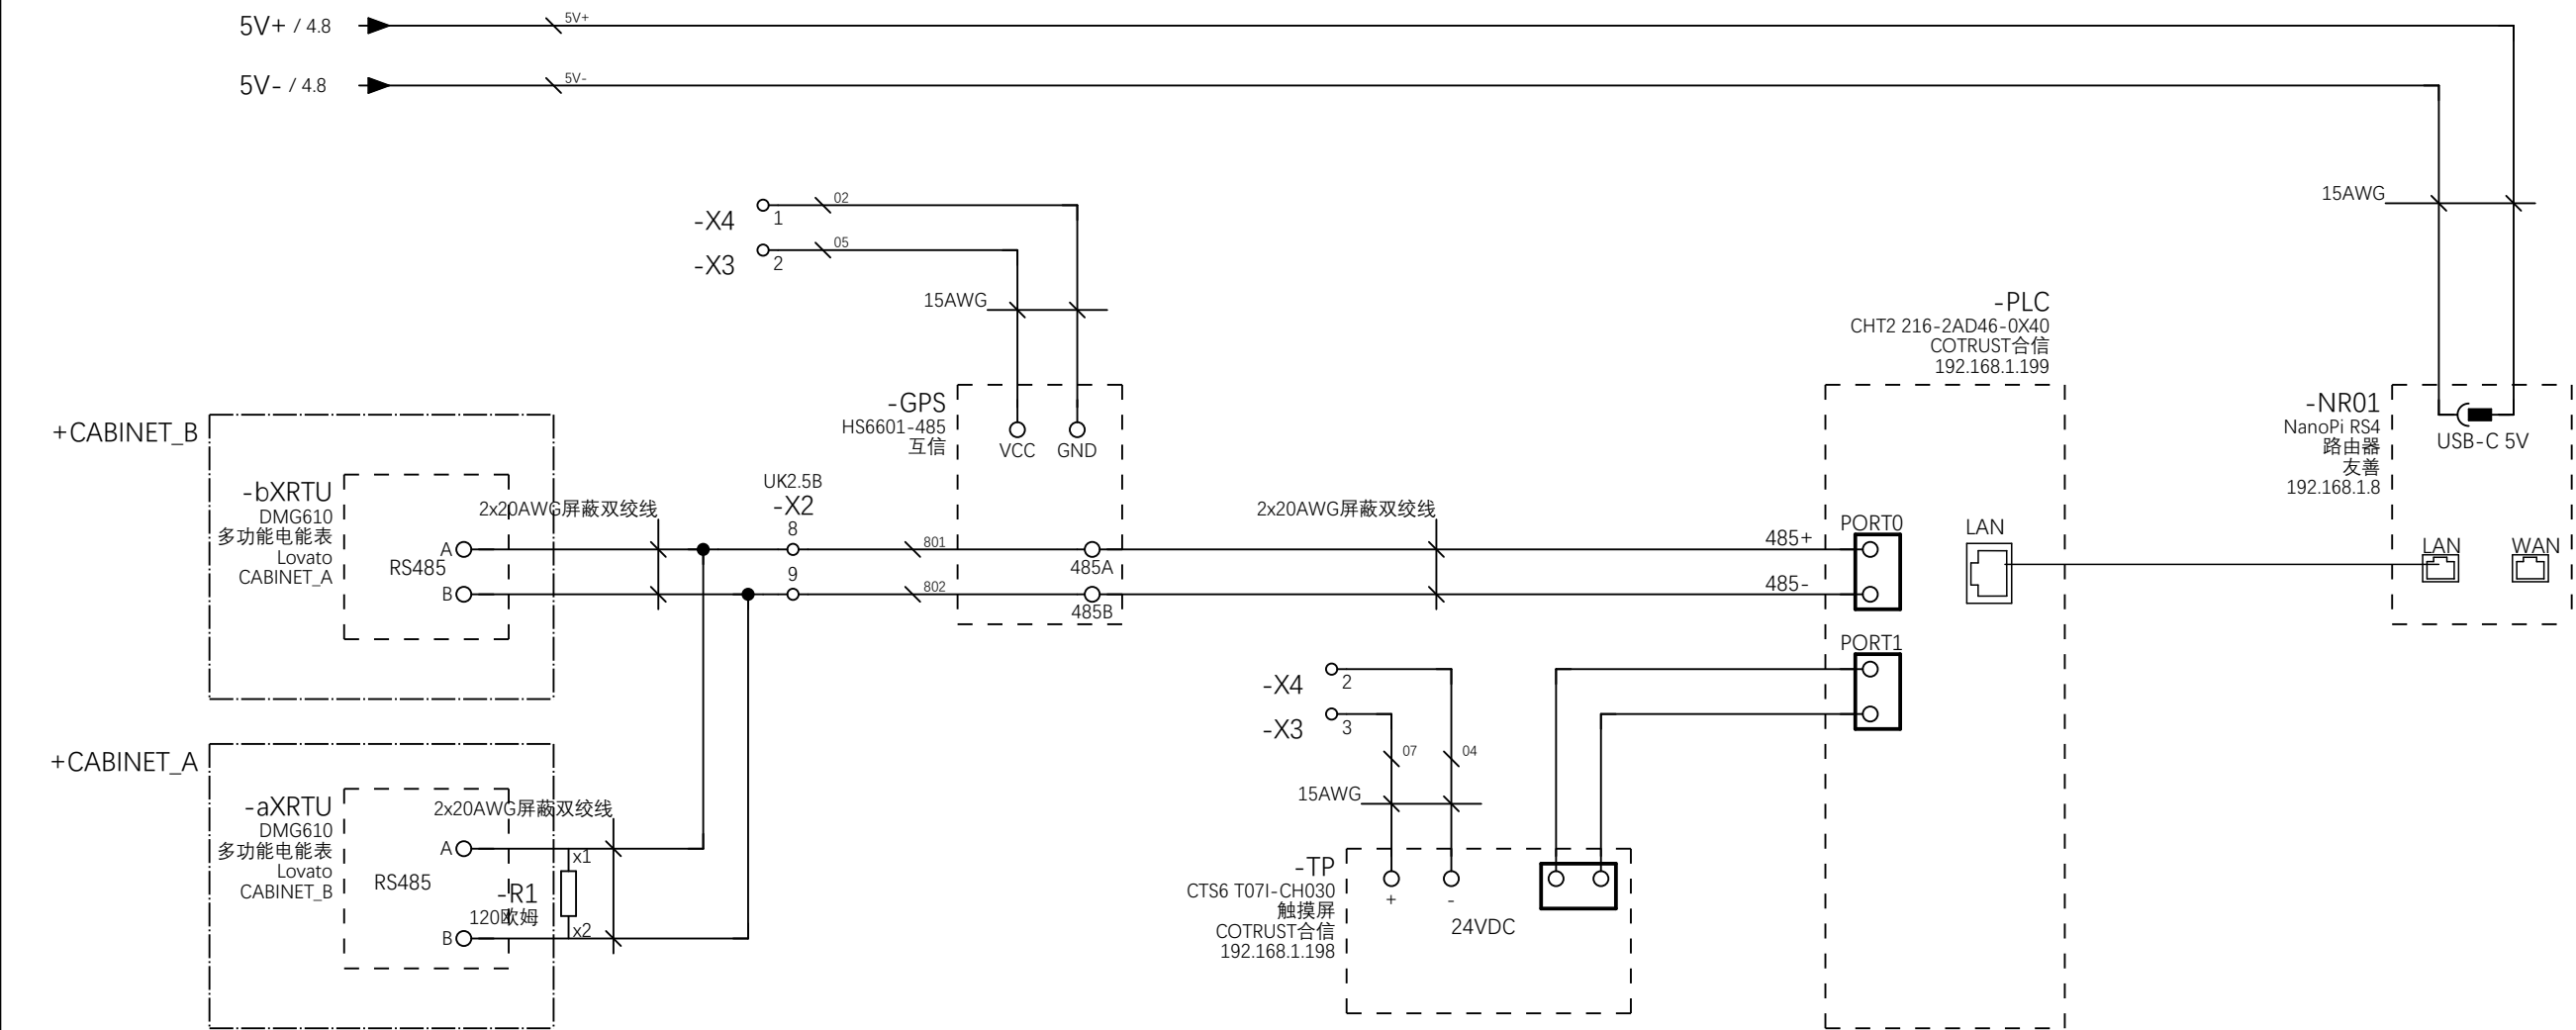

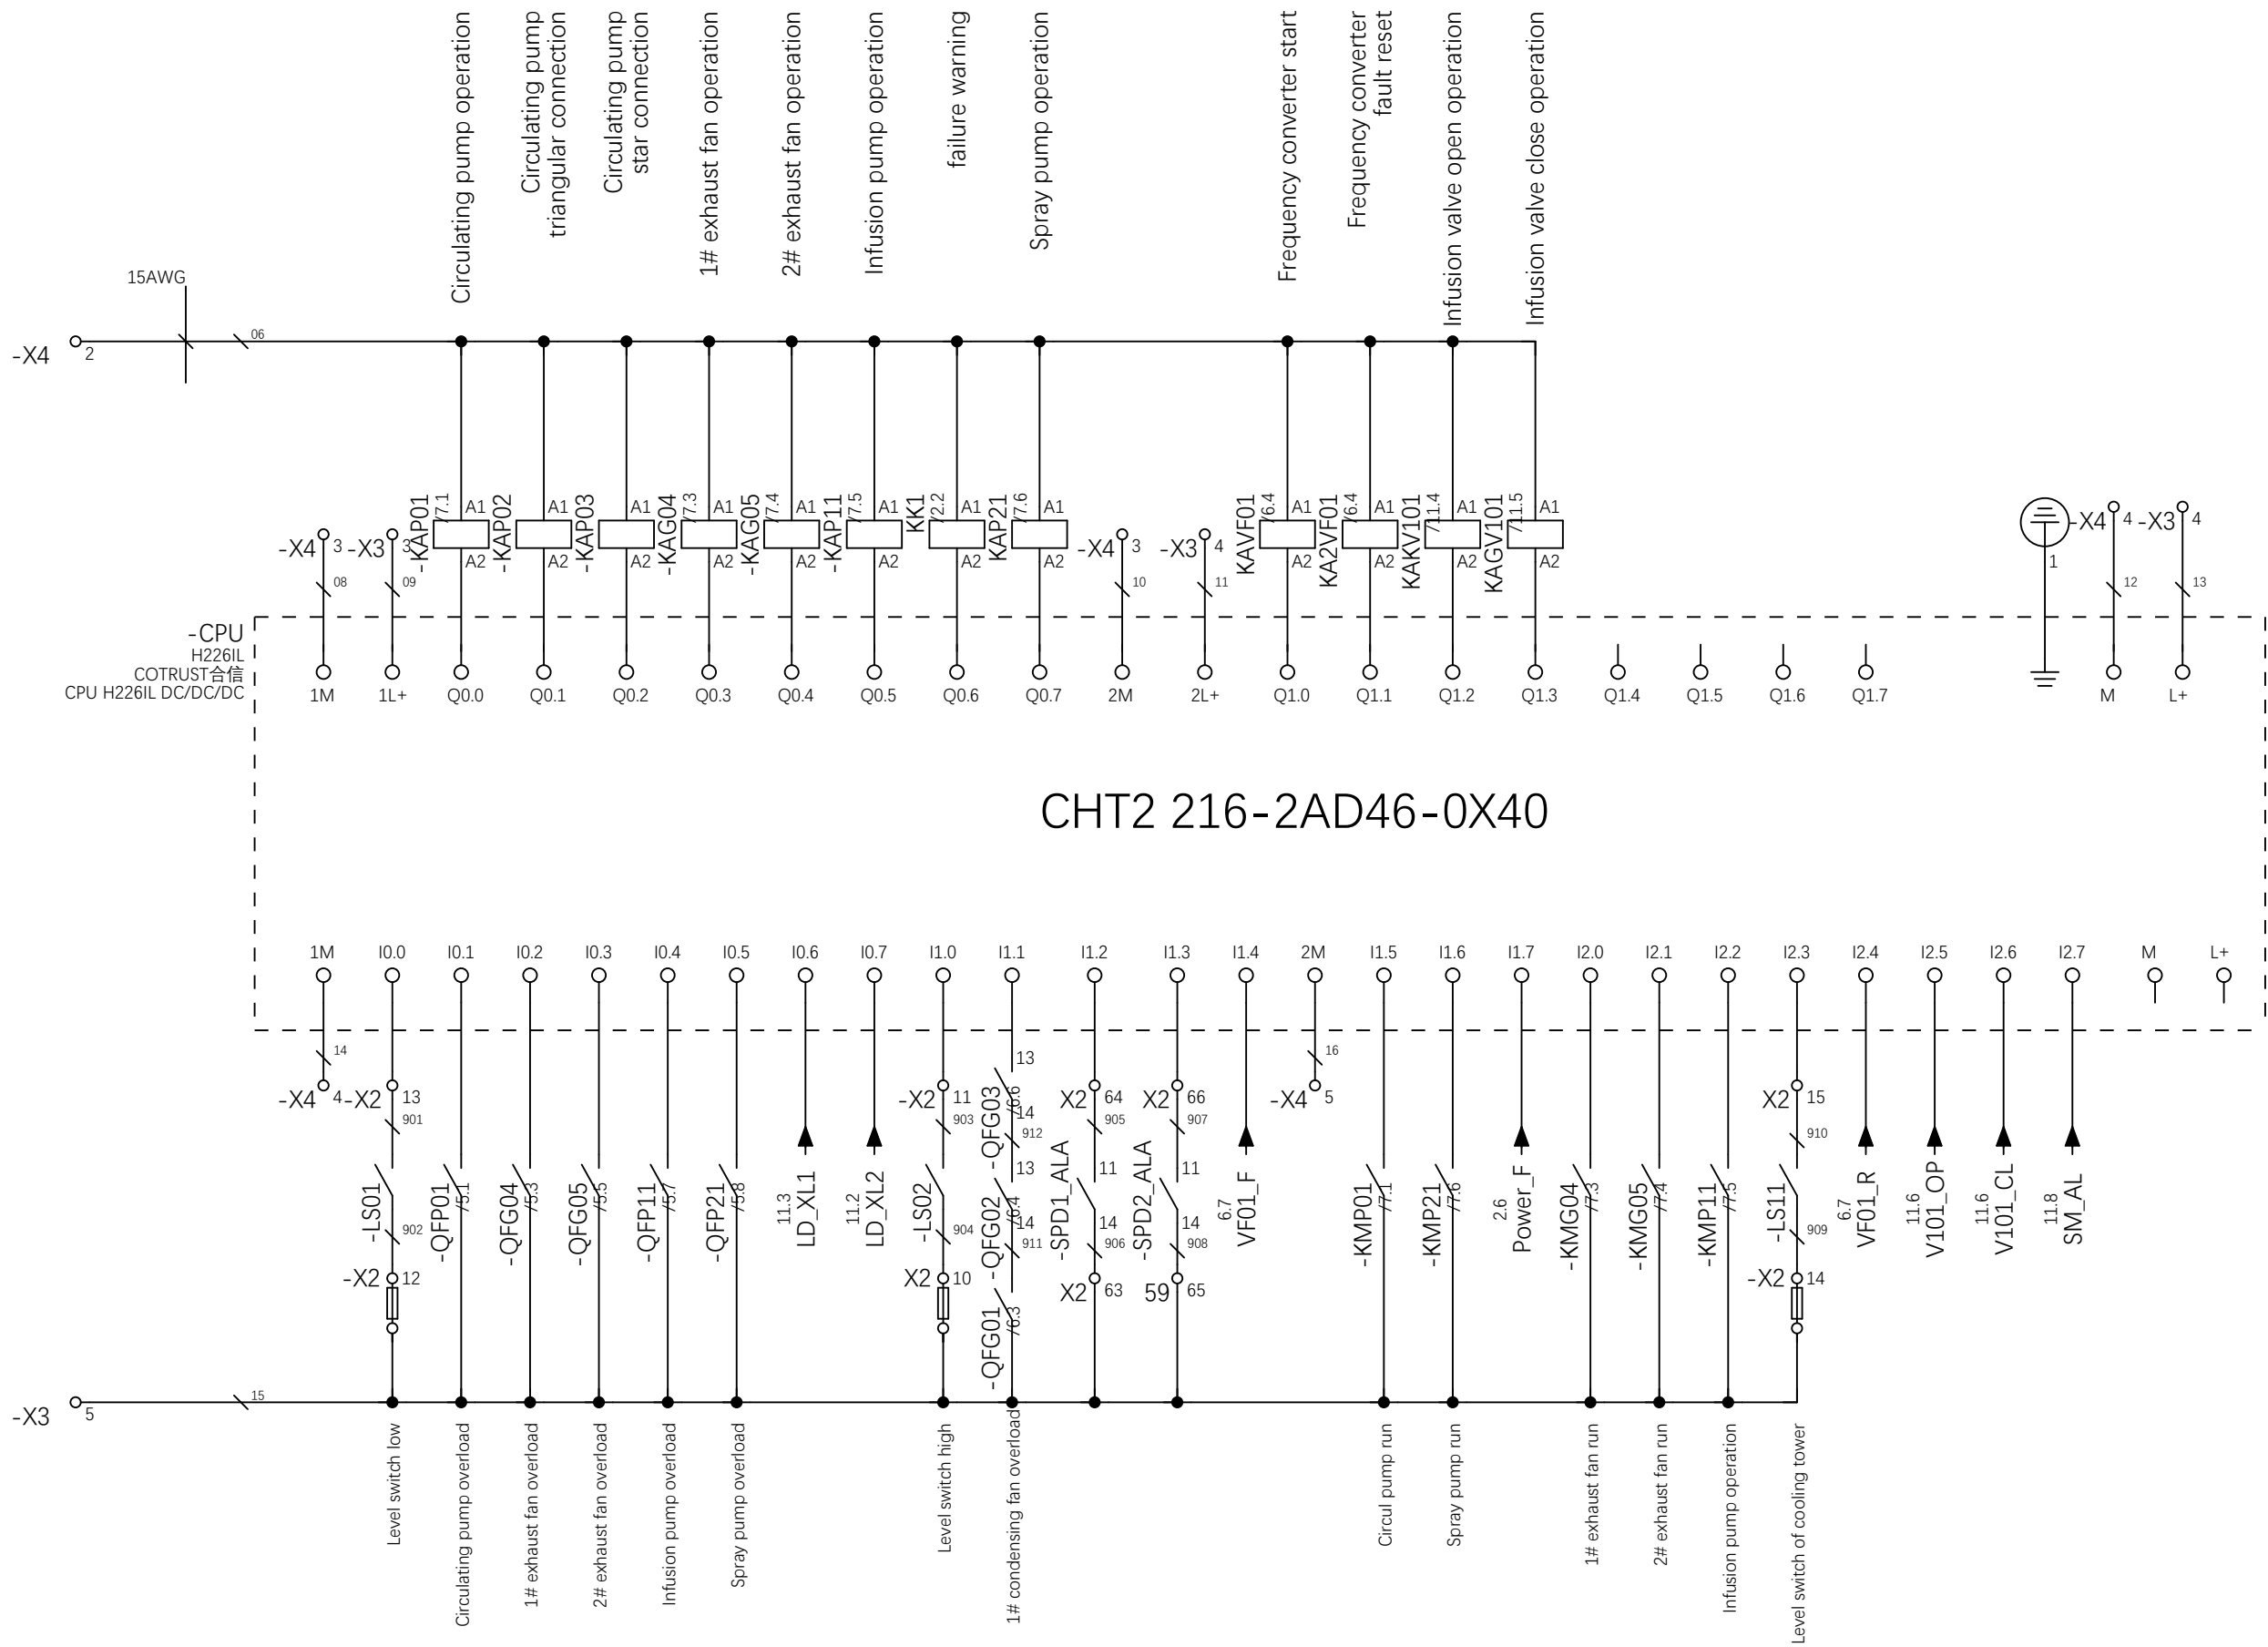

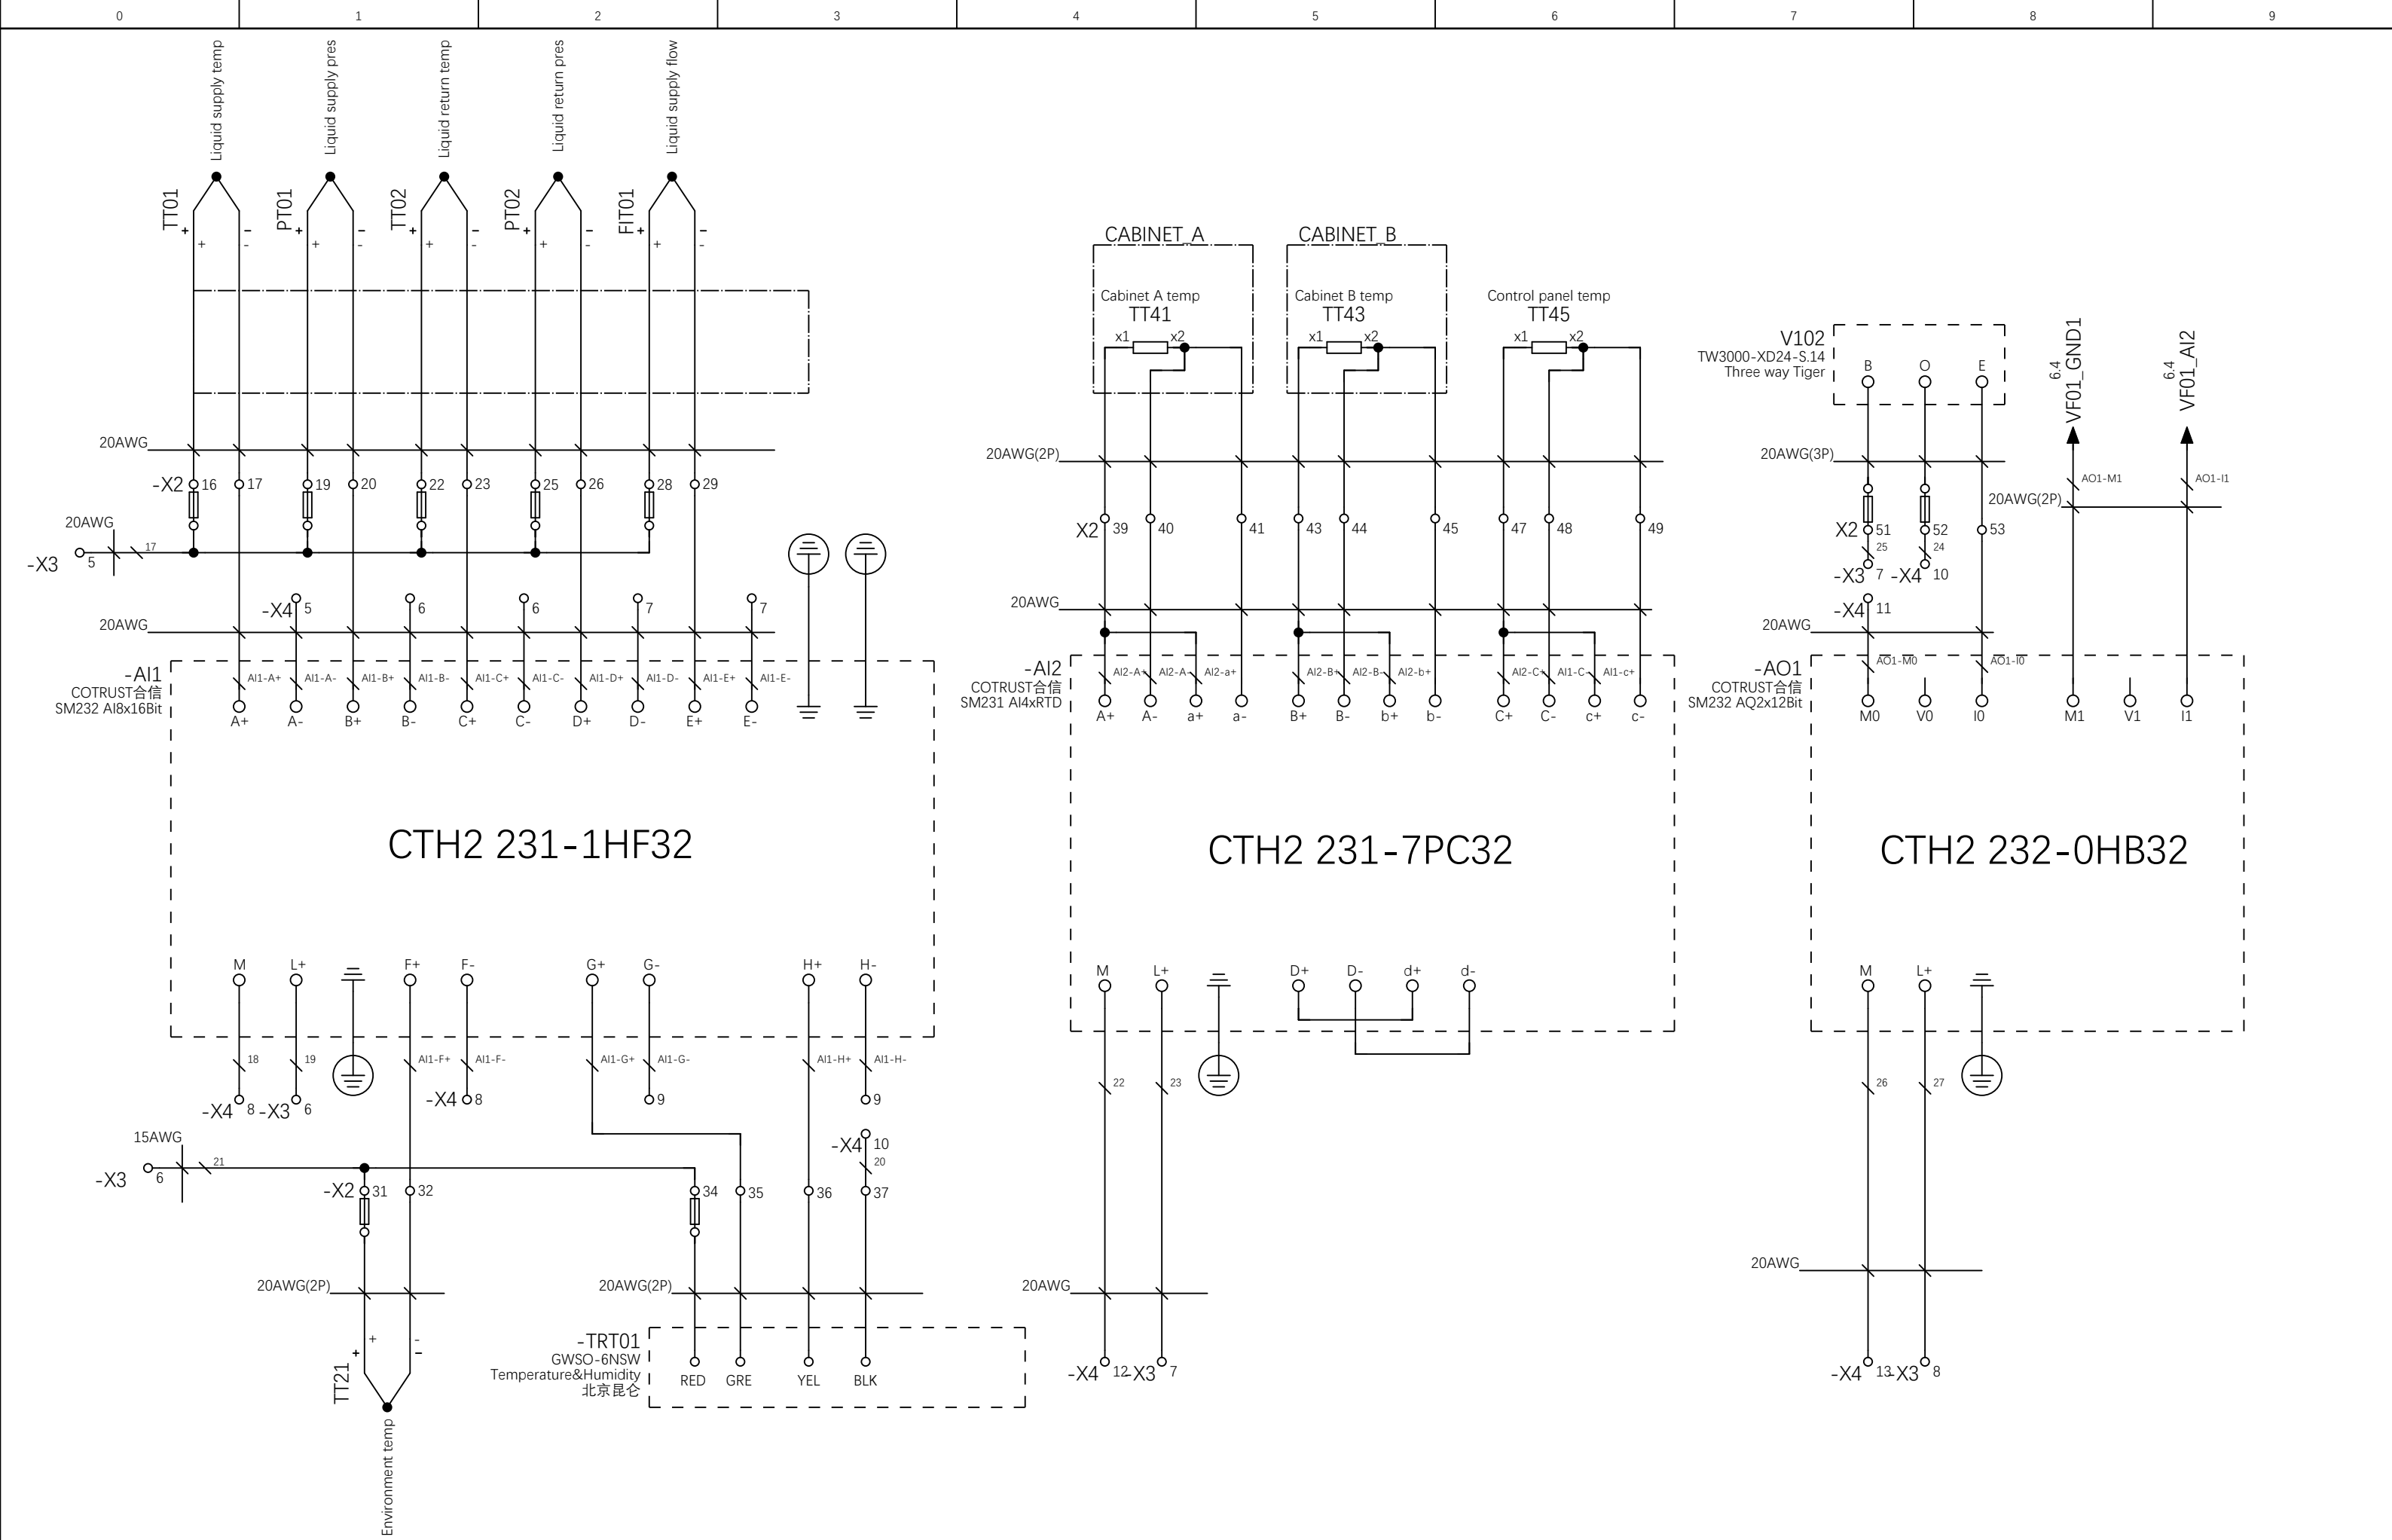

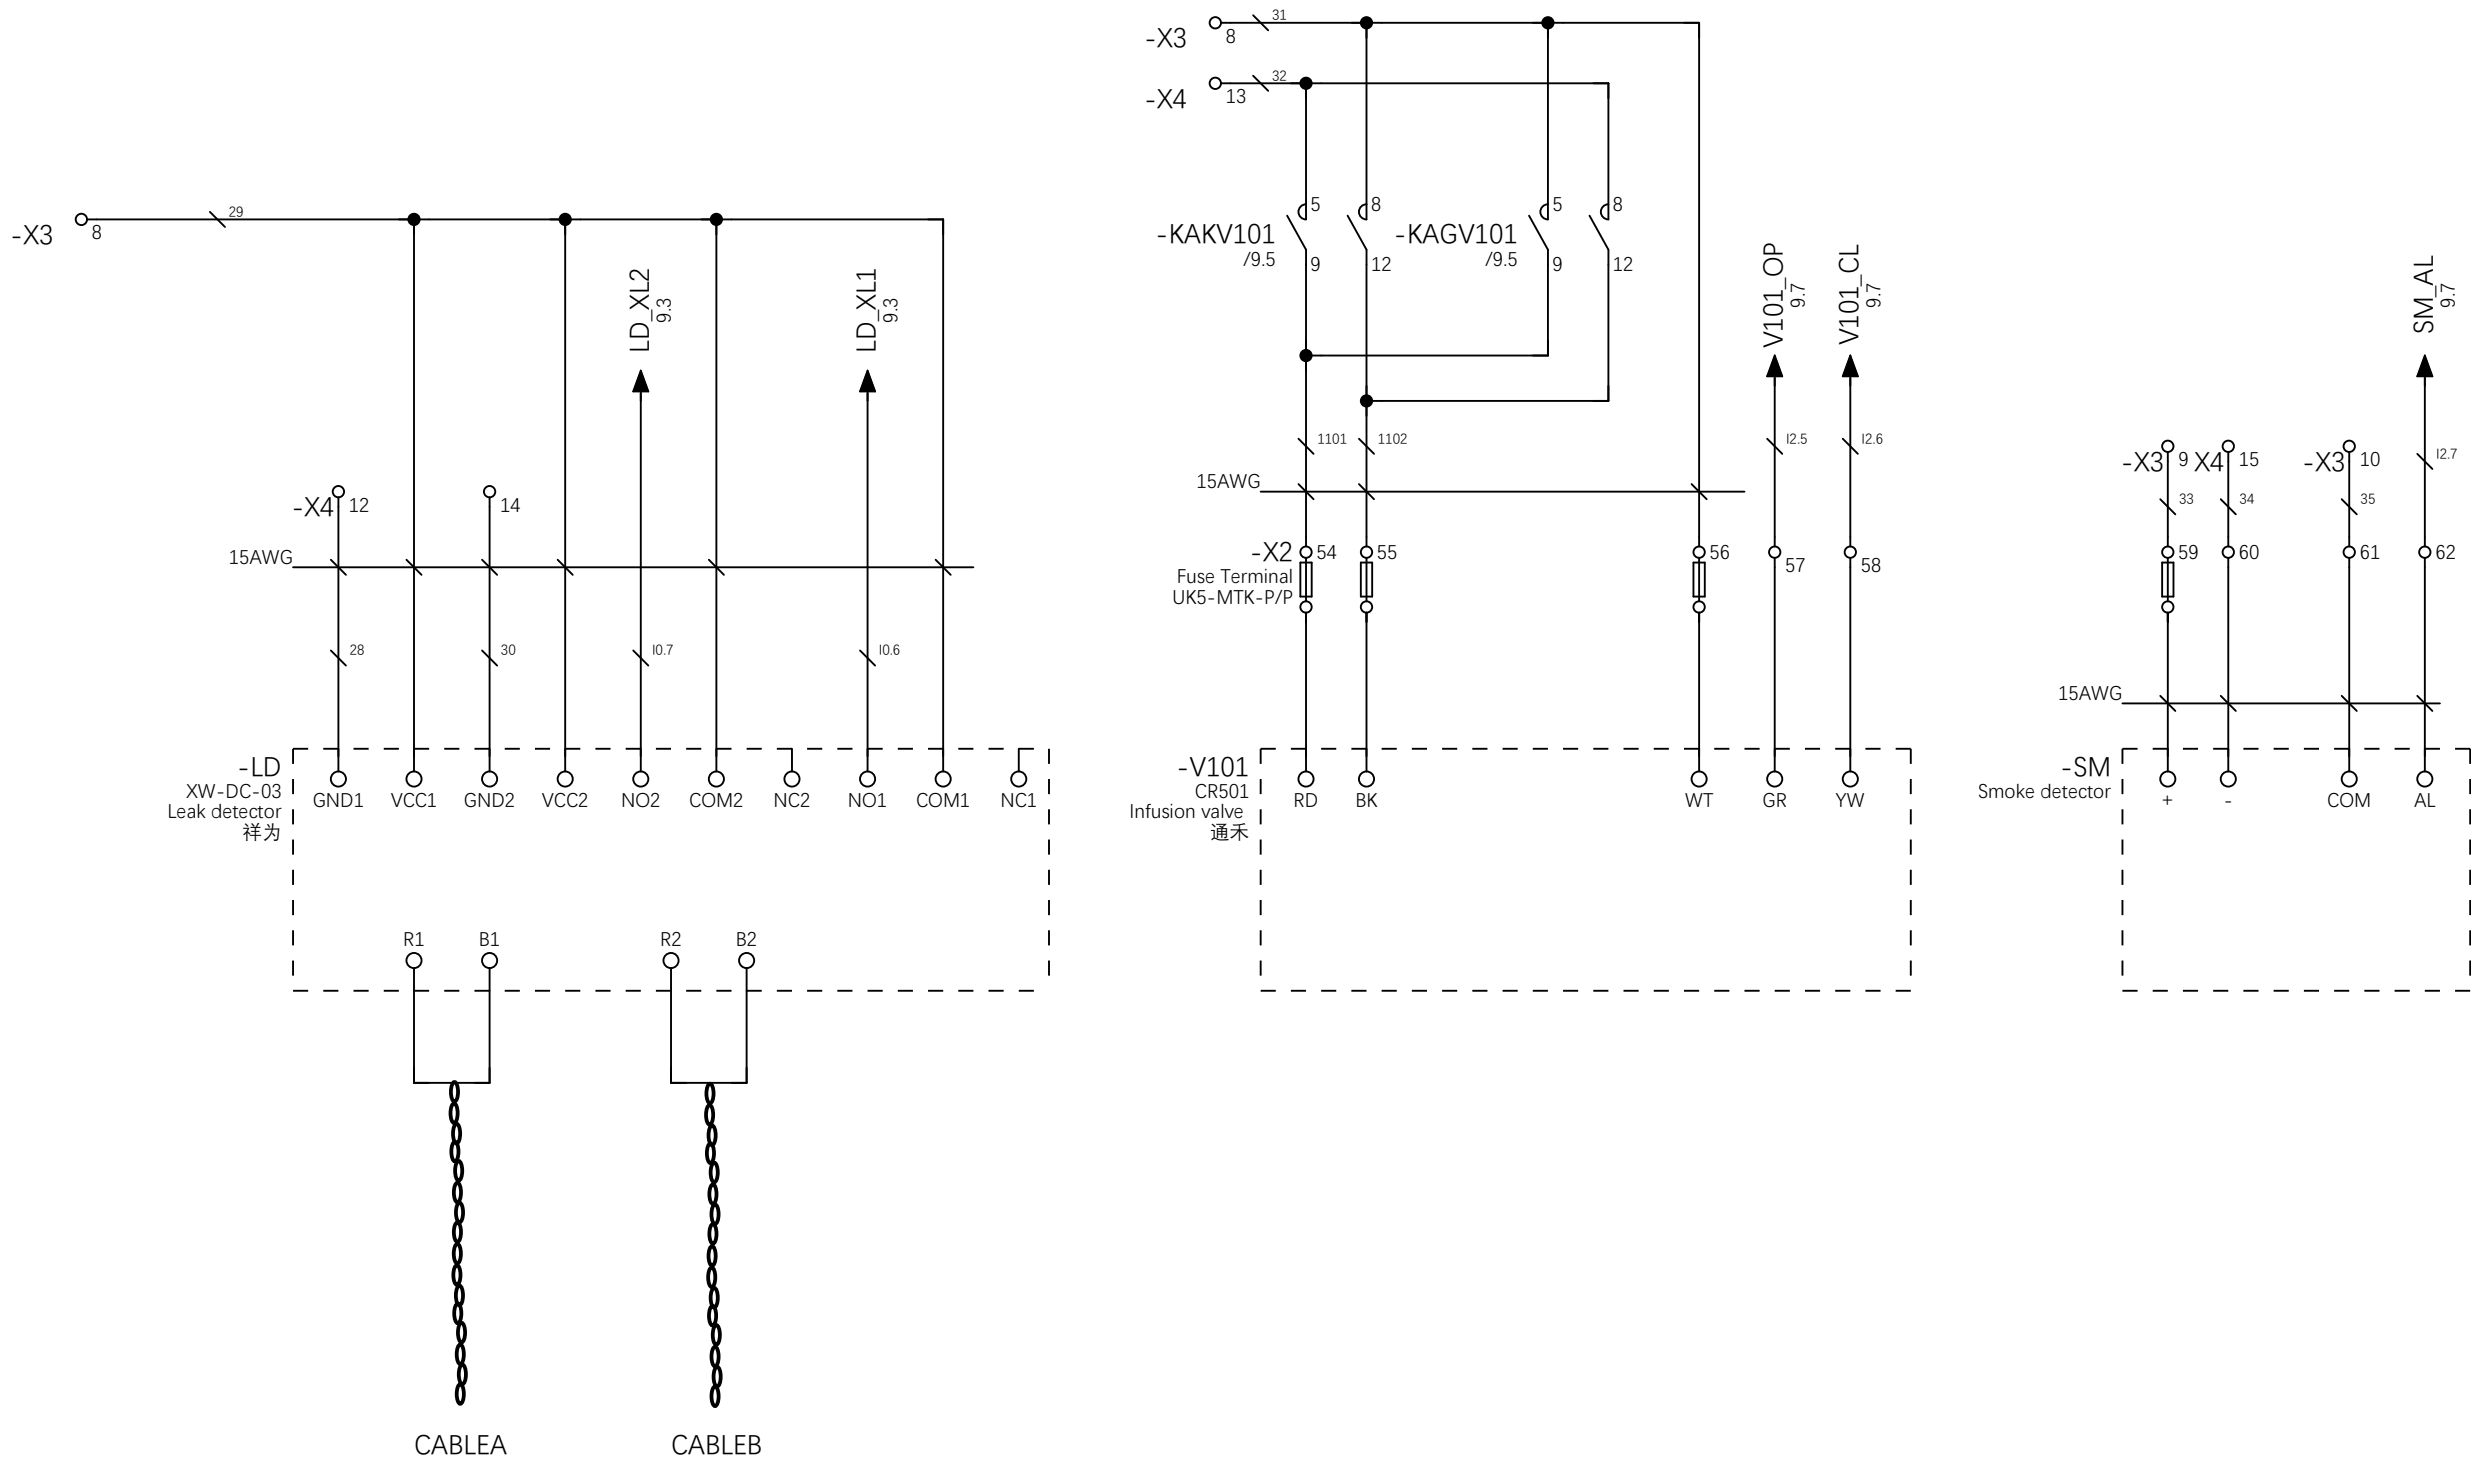

X1 电源端子排			
U11	1		
V11	2		
W11	3		
PE	4		
U12	5		
V12	6		
W12	7		
PE	8		
U21	9		
V21	10		
W21	11		
PE	12		
U22	13		
V22	14		
W22	15		
PE	16		
U3	17		
V3	18		
W3	19		
PE	20		
U4	21		
V4	22		
W4	23		
PE	24		
U51	25		
V51	26		
W51	27		
PE	28		
U52	29		
V52	30		
W52	31		
PE	32		
U53	33		
V53	34		
W53	35		
PE	36		
QFMF-2	37	04	ESB1-NO3
QFWCU-A1	38	05	ESB1-NO3
QFSW-2	39	19	
QFSW-4	40	20	
QFSW-2	41	19	
QFSW-4	42	20	
1L	43		
1N	44		
1L	45		
1N	46		

循环泵主电源

循环泵角接触器

1#散热风扇电源

2#散热风扇电源

补液泵电源

喷淋泵电源

1#冷却风机电源

2#冷却风机电源

3#冷却风机电源

集装箱急停按钮

配电柜A交换机电源

配电柜B交换机电源

配电柜A塑壳断路器脱扣线圈

配电柜B塑壳断路器脱扣线圈

X2 信号端子排			
24V L+	1		
402	2		
24V L-	3		
12V+	4		
12V-	5		
5V+	6		
5V-	7		
801	8	485A	PMMB-A
802	9	485B	PMMB-B
15	10	LS02	904
11.0	11	LS02	903
	12	LS01	902
10.0	13	LS01	901
	14	LS03	909
12.3	15	LS03	910
17	16	TT01+	
AI1-A+	17	TT01-	
PE	18	PE	
	19	PT01+	
AI1-B+	20	PT01-	
PE	21	PE	
	22	TT02+	
AI1-C+	23	TT02-	
PE	24	PE	
	25	PT02+	
AI1-D+	26	PT02-	
PE	27	PE	
	28	FIT01+	
AI1-E+	29	FIT01-	
PE	30	PE	
21	31	TT21+	
AI1-F+	32	TT21-	
PE	33	PE	
	34	TRT01-RED	
AI1-G+	35	TRT01-GRE	
AI1-H+	36	TRT01-YEL	
20	37	TRT01-BLK	
PE	38	PE	
AI2-A+	39		蓝色
AI2-A-	40		红色
AI2-a-	41		红色
PE	42	PE	屏蔽层
AI2-B+	43		蓝色
AI2-B-	44		红色
AI2-b-	45		红色
PE	46	PE	屏蔽层
AI2-C+	47		蓝色
AI2-C-	48		红色
AI2-c-	49		红色
PE	50	PE	屏蔽层

照明灯

照明开关

人脸识别

配电柜B电表通讯

冷却塔液位控制器

低液位

高液位

供液温度

供液压力

回液温度

回液压力

供液流量

环境温度

温湿度传感器

配电柜A温度

配电柜B温度

主控柜温度

25	51	V102-B	
24	52	V102-O	
AO-10	53	V102-E	
1101	54	V101-RD	
1102	55	V101-BK	
31	56	V101-WT	
12.5	57	V101-GR	
12.6	58	V101-YW	
33	59	SM+	
34	60	SM-	
35	61	SM-COM	
12.7	62	SM-AL	
15	63	906	SPD1-ALA-14
11.2	64	905	SPD1-ALA-11
15	65	908	SPD2-ALA-14
11.3	66	907	SPD2-ALA-11

配电柜A浪涌报警

配电柜B浪涌报警

X3 直流端子排24V+				
24V+	PW1+	1	KR-15	01
03	VF01-CM1	2	GPS-VCC	05
07	TP+	3	CPU-1L+ (DO)	09
11	CPU-2L+ (DO)	4	CPU-L+	13
15	X2:10	5	X2:16	17
19	AI1-L+	6	X2:31	21
23	AI2-L+	7	X2:51	25
27	AO1-L+	8	LD-VCC1	29
31	KAKV101-8	9	X2-59	33
35	X2-61	10		

X4 直流端子排24V-				
24V-	PW1-	1	GPS-GND	02
04	TP-	2	KAP01-A1	06
08	CPU-1M(DO)	3	CPU-2M(DO)	10
12	CPU-M(电源)	4	CPU-1M(DI)	14
16	CPU-2M(DI)	5	AI1	AI1-A-
AI1-B-	AI1	6	AI1	AI1-C-
AI1-D-	AI1	7	AI1	AI1-E-
18	AI1-M	8	AI1	AI1-F-
AI1-G-	AI1	9	AI1	AI1-H-
20	X2:37	10		
AO1-M0	AO1	11		
28	LD-GND1	12	AI2-M	22
32	KAKV101-5	13	AO1-M	26
24		14	LD-GND2	30
		15	X2-60	34